

## KEMA TYPE TEST CERTIFICATE OF SHORT-CIRCUIT PERFORMANCE

### **Sami Trafo Makina İnşaat İmalat Taahhüt Genel Ticaret Limited Şirketi**

Adana, Turkey

has successfully passed the type test sequence on a three-phase  
oil-immersed

#### **power transformer**

Type: STD-1600/33

Rating: 1600 kVA – 33,0 kV + 2 x 4,5454%, - 3 x 4,5454% / 0,40 kV  
– Dyn – 50 Hz

The test object passed the specification of test duties of


#### **IEC 60076-5**

The test results are recorded in Certificate No.

**2027-17**

This Certificate was issued on 26 April 2017.

DNV GL Netherlands B.V.

  
J.P. Fonteijne  
Executive Vice President  
KEMA Laboratories

**KEMA** Laboratories

© DNV GL

Please note that this document has been issued for information purposes only, and that the original bound and sealed paper copy of the Certificate including the results of the tests of the object will prevail. This document does not imply that DNV GL has certified or approved any object other than the specimen tested.



# Type test Certificate of short-circuit performance

## **SAMI TRAF0 MAKINA IMALAT INS. TAAH. GEN. TiC. LTD.STi.,**

Adana, Turkey

has successfully passed the type test sequence on a three-phase oil-immersed

### **distribution transformer**

Type: STD-1000/11

Rating: 1000 kVA – 11 kV  $\pm 2 \times 2,5\%$  / 0,416 kV – Dyn11 – 50 Hz

The test object passed the required clauses of


### **IEC 60076-5**

The test results are recorded in Certificate No.

## **2011-15**

This Certificate is issued on 24 February 2015

KEMA Nederland B.V.

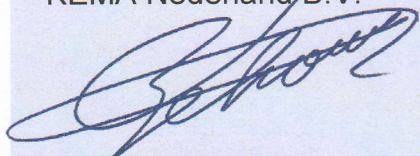

S.A.M. Verhoeven  
Director Testing, Inspections & Certification The Netherlands